

Type: M3PRC/S-4W (High Voltage)

Phase Failure, Phase Sequence, Under and Over Voltage plus Time Delay


- ❑ 35mm DIN rail housing
- ❑ Microprocessor controlled with internal monitoring (self-checking)
- ❑ Monitors own supply and detects if one or more phases exceed the set Under or Over Voltage trip levels
- ❑ Specifically suited to high voltage supplies of 575V or 600V phase to phase
- ❑ Unit measures phase to neutral voltage
- ❑ Detects incorrect phase sequence, phase loss and neutral loss
- ❑ Adjustments for under and over voltage trip levels
- ❑ Adjustment for time delay (from an under or over voltage condition)
- ❑ 1 x SPDT relay output 8A
- ❑ Intelligent LED indication for supply and relay status

Dims:
to DIN 43880
W. 35mm



Terminal Protection to IP20

FUNCTION DIAGRAM

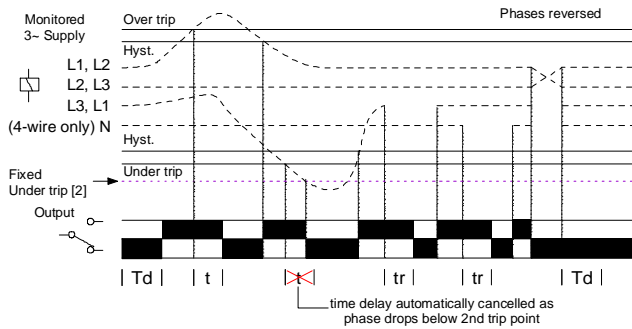

INSTALLATION AND SETTING



Installation work must be carried out by qualified personnel.

- BEFORE INSTALLATION, ISOLATE THE SUPPLY.
- Connect the unit as required. The diagram below shows a typical installation, whereby the supply to the load is being monitored by the relay. If a fault should occur (i.e. fuse blowing), the contactor is de-energised removing the 3-phase supply to the load. The contactor only re-energises after the fault has cleared.

Applying power.

- Set the "over %" adjustment to maximum and the "under %" adjustment to minimum. Set the "time delay" to minimum.
- Apply power and the green "supply on" and red "relay" LED's will illuminate, the relay will energise and contacts 15 and 18 will close. Refer to the troubleshooting table if the unit fails to operate correctly.

Setting the unit.


- Set the "over %" and the "under %" adjustments to give the required monitoring range.
- If large supply variations are anticipated, the adjustments should be set further from the nominal voltage.
- Set the "time delay" as required. (Note that the delay is only effective should the supply increase above or drop below the set trip levels. However, if during an under voltage condition the supply drops below the 2nd under voltage trip level, any set time delay is automatically cancelled and the relay de-energises).

Troubleshooting.

The table below shows the status of the unit during a fault condition.

Supply fault	Green LED	Red LED	Relay
Phase or Neutral missing	Off	Off	De-energised
Phases reversed (no delay)	Flashing	Off	De-energised
Under or Over Voltage condition (during timing)	On	Flashing	Energised for set delay (t)
Under or Over Voltage condition (after timing)	On	Off	De-energised
Phase below 70% of Un (fixed under trip level [2])	On	Off	De-energised
Phase below 50% of Un	Off	Off	De-energised

CONNECTION DIAGRAM

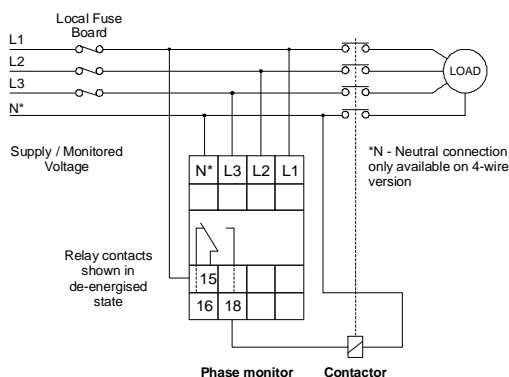

TECHNICAL SPECIFICATION

Supply / monitoring voltage Un*

(L1, L2, L3, N): 332, 346V AC (phase to neutral)

Frequency range: 48 - 63Hz

Supply variation: 70 - 130% of Un

Isolation: Over voltage cat. III

Rated impulse withstand voltage: 6kV (1.2 / 50µS) IEC 60664

Power consumption: L1: 20VA (max.)
L2: 0.1VA
L3: 0.1VA

Trip levels:

Under [2]: 70% of Un (fixed) (± 2%)

Under: 75 - 95% of Un

Over: 105 - 125% of Un

Measuring ranges**:
332V: 249 - 315V Under 348 - 415V Over
346V: 259 - 329V Under 363 - 432V Over

** measured phase to neutral

Repeat accuracy: ± 0.5% @ constant conditions

Hysteresis: ≈ 2% of trip level (factory set)

Response time: ≈ 50 mS

Time delay (t): 0.2 - 10 sec (± 5%)

Note: actual delay (t) = adjustable delay + response time

Delay from

phase/neutral loss (tr): ≈ 100 mS (worst case = tr x 2)

Power on delay (Td): ≈ 1sec. (worst case = Td x 2)

Ambient temp: -20 to + 60°C

Relative humidity: + 95%

Output (15, 16, 18): SPDT relay

Output rating:
AC1 250V 8A (2000VA)
AC15 250V 5A (no), 3A (nc)
DC1 25V 8A (200W)

Electrical life: ≥ 150,000 ops at rated load

Dielectric voltage: 2kV AC (rms) IEC 60947-1

Rated impulse withstand voltage: 4kV (1.2 / 50µS) IEC 60664

Housing: Orange flame retardant UL94 VO

Weight: ≈ 120g


Mounting option: On to 35mm symmetric DIN rail to BS5584:1978 (EN50 002, DIN 46277-3) Or direct surface mounting via 2 x M3.5 or 4BA screws using the black clips provided on the rear of the unit.

Terminal conductor size: ≤ 2 x 2.5mm² solid or stranded

Approvals: Conforms to UL & IEC. CE and Compliant.

* Voltage must be stated when ordering. For other supply/monitoring voltages, please contact the sales office.

MOUNTING DETAILS

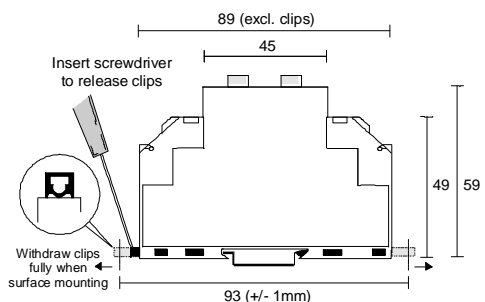

Broyce Control Ltd., Pool Street, Wolverhampton, West Midlands WV2 4HN, England M3PRCS-4W [HIGH VOLTAGE]-3-A

Telephone: +44 (0) 1902 773746 Facsimile: +44 (0) 1902 420639 Email: sales@broycecontrol.com Web: http://www.broycecontrol.com
The information provided in this literature is believed to be accurate (subject to change without prior notice); however, use of such information shall be entirely at the user's own risk.