# Type: P9620


# Definite Time (DT) Earth Fault Relay

- True R.M.S. measurements
- Adjustable Low-set tripping threshold
- Adjustable High-set tripping threshold with option to disable
- Adjustable Definite Time setting (applicable to Low-set triggering only)
- Instantaneous tripping on High-set triggering
- Test and Reset button for simulating and clearing of fault condition
- Red LED indication of Low-set or High-set triggering and tripping
- $\Box$ Green LED indication for Auxiliary power supply presence
- Microprocessor based (self checking) with non-volatile memory
- Terminals suitable for 2 x 2.5mm<sup>2</sup> wires (complete with protective cover)





# **PRESENTATION**

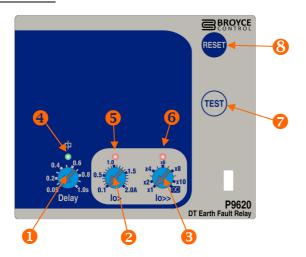

- 1. "Delay" adjustment\*
- 2. "Low-set Io>" trip adjustment\*3. "High-set Io>>" trip adjustment\*
- 4. "Power supply" green LED indication
- 5. "Low-set triggered" red LED indication
- 6. "High-set triggered" red LED indication
- "TEST" button
- 8. "RESET" button
- \* accessible only when the front cover is open

## **OPERATION**

#### Example 1.

When an Earth fault occurs and the level of current exceeds the "Low-set lo>" trip threshold, the corresponding red LED above the adjustment illuminates. If the current remains for greater than the time delay set by the adjustment marked "Delay", the relay will then energise. The red LED will then flash indicating a tripped condition.

If the fault current has been removed, pressing the "RESET" button will return the relay back to normal operation. The red LED will then extinguish.

#### Example 2.

If a fault current occurs such that it exceeds the "High-set lo>>" trip threshold (and before the "Delay" has had time to elapse), the relay will de-energise with no delay. The red LED above the "High-set lo>>" adjustment will flash.

In the event of an Earth fault condition, the basic sequence of events is shown below.

Assuming High-set trip is enabled.


# **GENERAL OVERVIEW**

The P9620 (from the P9600 series family of IDMT/DT relays) is a microprocessor based relay designed to monitor and detect Earth faults in 3-phase applications. Typically the P9620 is wired in conjunction with external current transformers of the feeder to be protected.

The adjustments and indicators are laid out such to help the user during set-up and fault finding. The adjustment for the Low-set for example has its corresponding red LED positioned above it so it is clear to which function this LED relates to. The same also applies to the Highset adjustment and LED. Adjustment and LED operation is explained further on the next page.

The adjustable time delay **Delay** is assigned to the **Low-set** triggering only. The **High-set** does not have any adjustable delay and hence will trip instantaneously if triggered. If required, the High-set can be set to disabled.

A Test mode is provided (also accessible with the tamperproof transparent cover closed) to confirm the correct operation of the internal relay. The relay will energise when the "TEST" button is pressed and de-energise when the "RESET" button is pressed.

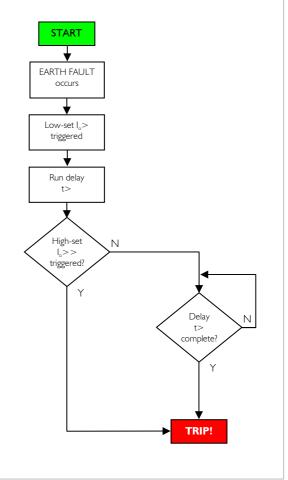

## INSTALLATION



Installation work must be carried out by qualified personnel.

- BEFORE INSTALLATION, ISOLATE THE SUPPLY. THIS PRODUCT IS
  DESIGNED TO CONNECT TO SEVERAL TYPES OF CIRCUITS.
  ENSURE ALL ARE ISOLATED
- Remove the P9620 from the packaging.
- Lift the raised part of the side clip in order to remove from the housing. Carry this out on each side.
- Insert the P9620 into the panel cut-out and fit the side clips back on to the housing.
- Slide the clips towards the front of the unit until they come in to contact with the reverse of the panel. The unit is now secured in place.
- Connect wires to the rear terminals as required.
- The P9620 is now ready for powering and setting.

 ${}^{\smile}$  The front window of the P9620 is supplied with a clear protective film which can be removed as and when necessary.

# NORMAL OPERATION

• Apply power to the unit and the green "Power supply" LED will illuminate.



## TEST MODE

- Press and hold the TEST button and the relay will energise. Both the red "lo>" and "lo>>" LED's will illuminate.
- Release the TEST button and the relay will remain energised.
- Press the Press the relay. Both red LED's will extinguish.

 ${}^{\smile}$  Testing should be carried out on a regular basis to check the integrity of the P9620.



DO NOT use this product to provide a means of isolating circuits in order to work on when placed in the **"TEST"** mode. This should only be done by means of operating isolators, circuit breakers or other methods of removing power in this application.

#### SETTING & OPERATION

Setting of the P9620 is carried out using the 3 potentiometers located behind the transparent cover.

#### I. Delay



The adjustment for "Delay (s)" sets the period that the P9620 waits before the relay energises once the "Low-set" threshold "lo>" has been exceeded.

#### 2. Low-Set Trip threshold (lo>)



The adjustment for the "Low-set" can be set from 0.1 to 2A. When the threshold is exceeded due to an Earth fault condition, the corresponding red LED above the adjustment illuminates indicating activity. When tripping finally occurs, the red LED will then flash.

## 3. High-Set Trip threshold (lo>>)



The adjustment for the "High-set" can be set from x1 to x10 then disable i.e.

The scale markings are multipliers of what has been set on the "Low-set" threshold. For example if the "Low-set" is set to 1.5A and "High-set" x6, this will be the equivalent of 1.5 x 6 = 9A.

When the threshold is exceeded due to an Earth fault condition, the corresponding red LED above the adjustment illuminates indicating activity. When tripping finally occurs, the red LED will then flash.

The tripping occurs whereby the High-set level is exceeded, only the LED for the High-set will illuminate/flash. This allows the user to clearly identify which threshold was triggered causing the trip.

There is no delay associated with High-set therefore, tripping is instantaneous.

#### LED FUNCTION SUMMARY

 $\ ^{\circ}$  The green LED will remain illuminated for as long as power is applied to the Aux. connections (Terminals 1 and 2).

In response to an Earth fault condition:

Status	lo>	lo>>
Normal		
Low-set triggered		0
Low-set Tripped	÷	0
High-set triggered	0	
High-set Tripped	0	*

In response to Test and Reset button operation:

Button press	lo>	lo>>
TEST		
RESET	0	0

Key:





## **TECHNICAL SPECIFICATION**

Supply voltage Un (I, 2): 115VAC ±15%

230VAC ±15%

(Voltage should be specified at time of ordering)

50/60Hz

Rated frequency: Over voltage cat. III Isolation:

Rated impulse

4kV (1.2 / 50µS) IEC 60664 withstand voltage:

Power consumption: 3W max.

Rated current input In: 5A (directly connected)

Rated frequency: 50Hz <0.4VA @ In Burden: Overload: 4 x In (continuous)

External CT's (15, 16): Class P recommended. (with 5A secondary)

Earth fault settings:

Low-set trip  $(I_o>)$ : 0.10 - 2.0A(2 - 40%)

0.05 - 1.0sLow-set definite time (t>):

xI - xI0 or disable ( $\bigcirc$ ) High-set trip  $(I_0 >>)$ : Instantaneous (<50mS) High-set definite time:

Pick up value: Accuracy:

+2% of trip setting

Protection thresholds:

+ 5%

Time delay (DT): ± 5% (with a minimum of 50mS) Repeat accuracy: ± 0.5% @ constant conditions

-10 to +60°C Ambient temperature:

+95% (non-condensing) Relative humidity:

Output:

(RLI - 3, 4, 5): I x SPDT relay


ACI 250V 8A (2000VA) Output rating:

AC15 250V 5A (1250VA) DCI 25V 8A (200W)


Electrical life:  $\geq$  150,000 ops at rated load 2kV AC (rms) IEC 60947-1 Dielectric voltage:

Rated impulse

withstand voltage: 4kV (1.2 / 50µS) IEC 60664



Max. DC Load Breaking Capacity



Electrical Endurance

Housing: Flame retardant I exan Protection: IP55 / IP20 (rear)

≈ 450g Weight:

Mounting: Panel mounting. Cut-out =  $91 \times 91 \text{mm} (\pm 0.5 \text{mm})$ 

Max. panel thickness:

0.05 - 2.5mm<sup>2</sup> (30 - I2AWG) Terminal conductor size:

Recommended tightening

10in lb (1Nm) toraue:

0.24 - 0.30in (6 - 7.5mm) Wire stripping length:

Conforms to IEC. CE and **©** and RoHS Compliant. Approvals:

EMC: Immunity: EN/IEC 61000-6-2

Emissions: EN/IEC 61000-6-4 Generic: IEC 60255-26 (EMC), IEC 255-3, IEC


60255-151

() Bold digits in brackets refer to terminal numbers on the rear of the unit.

#### Options:

The P9600 range also includes individual Overcurrent or Earth fault relays available with either IDT or IDMT tripping characteristics. Please refer to separate data sheets.

# **CONNECTION DIAGRAM**



# **DIMENSIONS**

