


Type: LCVR/2 **Under and Over Voltage plus Time Delay**

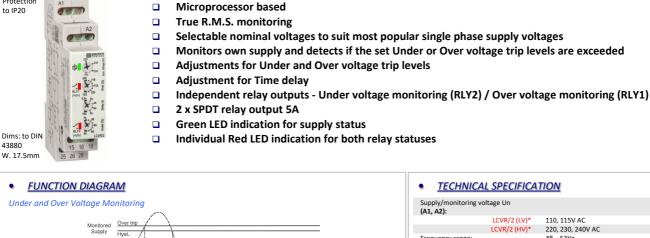

Compact 17.5mm DIN rail housing

Installation work must be carried out by qualified personnel.

43880 W. 17.5


•

Terminal

Protection

to IP20



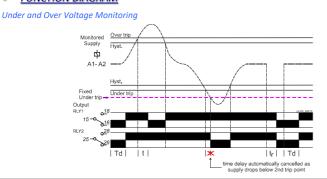

INSTALLATION AND SETTING

- BEFORE INSTALLATION, ISOLATE THE SUPPLY
- Connect the unit as required. The Connection Diagram below shows a typical installation, whereby the supply to a load is being monitored by the Voltage monitoring relay. If a fault should occur (i.e. fuse blowing), the relay will de-energise and assuming control of the external Contactor, de-energise the Contactor as well.

Applying power.

- Set the "Nominal (Un)" **3** voltage selector to match that of the voltage being monitored.
- Set the Over %" 😉 adjustment to maximum and the "Under %" 🕖 adjustment to minimum. Set the "Delay (t)" 🛈 to minimum.
- Apply power and the green "Power supply" 1 LED will illuminate. Both the red "RLY1" 2/"RLY2" 8 LED's will illuminate and corresponding RLY1 and RLY2 relays energise after the short Power on delay (Td).
- Refer to the Troubleshooting table if the unit fails to operate correctly.

Setting the unit (with power applied).

- Set the "Over %" and the "Under %" adjustments to give the required monitoring range.
- If large supply variations are anticipated, the adjustments should be set further from the nominal voltage. Set the "Delay (t)" adjustment as required. (Note that the delay is only effective should the supply increase above or drop below the set trip levels. However, if during an under voltage condition the supply drops below the 2nd under voltage trip level, any set time delay is automatically cancelled and both relays de-energise immediately)


Troubleshooting.

٠

The table below shows the status of the unit during a particular fault condition

Supply fault	Green LED	Red LED	Red LED ତ	Relay RLY1	Relay RLY2
Under voltage condition (during timing)	On	On	Flashing	Energised	En for delay (t)
Under voltage condition (after timing)	On	Off	Off	Energised	De-energised
Over voltage condition (during timing)	On	Flashing	On	En for delay (t)	Energised
Over voltage condition (after timing)	On	Off	On	De-energised	Energised
Supply < fixed under trip level [2]	On	Off	Off	De-energised	De-energised

• <u>TECHNICAL</u>	SPECIFICA	HUN					
Supply/monitoring volt (A1, A2):	-						
	LCVR/2 (LV)*	110, 115V AC					
	LCVR/2 (HV)*	220, 230, 240V AC					
Frequency range:		48 – 63Hz					
Supply variation:		EV. 70 - 1507 HV. 140 - 5157 AC					
Overvoltage category:		III (IEC 60664) variant when					
Rated impulse withstar		4kV (1.2/50μS) IEC 60664 ordering					
Power consumption (m	ax.):	2.5VA					
Monitoring mode: Trip levels:		Under and Over voltage					
	Under [2]:	Fixed ± 2% see below					
	Under:	75 – 95% of Un					
	Over:	105 – 125% of Un					
Measuring ranges:		Nominal (Un)	Under [2]	Under	Over		
	LCVR/2 (LV)	110V	70V	83 - 105V	116 - 138V		
		115V	74V	156 – 198V	218 - 260V		
	LCVR/2 (HV)	220V	140V	165 – 209V	231 – 275V		
		230V	147V	173 – 219V	242 – 288V		
		240V	153V	180 - 228V	252 - 300V		
Hysteresis:		≈ 2% of trip leve	(factory set)				
Setting accuracy:		± 3%					
Repeat accuracy:		± 0.5% at constant conditions					
Immunity from micro p	ower cuts:	<50ms					
Response time:		≈ 50ms					
Time delay (t):		0.2 – 10s (± 5%)					
		Note: actual delay (t) = adjustable delay + response time					
Power on delay (Td):		≈ 1s (worst case		, ,			
Reset time:		50 - 100ms					
Power on indication:		Green LED					
Relay status indication:		Red LED x2					
,							
Ambient temperature:		-20 to +60°C					
Relative humidity:		+95% max.					
Output (15, 16, 18 / 25	. 26. 28):	2 x SPDT relay					
Output rating:	,,,	AC1		250V 5A (125	50VA)		
		AC15		250V 2A	,		
		DC1		25V 5A (125)	W)		
Electrical life:		≥ 150,000 ops at	rated load				
Dielectric voltage:		2kV AC (rms) IEC					
Rated impulse withstar	Rated impulse withstand voltage: 4kV (1.2/50µS) IEC 60664						
Housing:	-	Grey flame retar	dapt UL04				
Weight:		90g	uant 0194				
Mounting option:			motric DIN ra	il to BS EN 60715	or direct		
woulding option.		On to 35mm symmetric DIN rail to BS EN 60715 or direct surface mounting via 2 x M3.5 or 4BA screws using the black					
		clips provided or			ing the black		
Terminal conductor size		$\leq 2.5 \text{mm}^2 \text{ solid of}$		ie unit.			
Terminal screw:	-	M2.5					
Tightening torque:		0.4Nm (3.5Lb-In) Max.					
Approvals:		Conforms to IEC.					
			IND. CON E1	IT. EQ.			
		CE, UKCA, Cand RoHS Compliant. EMC:					
		LIVIC.					

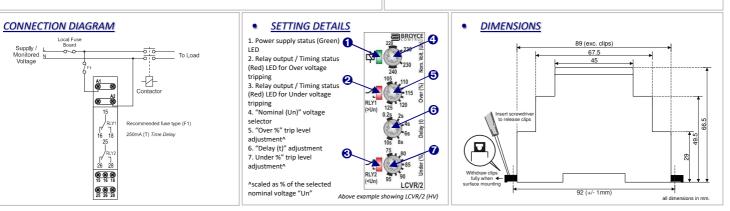

HS Code: 85364900 Country of Origin: UK Broyce Control Ltd., Pool Street, Wolverhampton, West Midlands WV2 4HN. England

Tel: +44 (0) 1902 773746 Fax: +44 (0) 1902 420639 Email: sales@broycecontrol.com Web: www.broycecontrol.com The Information provided in this literature is believed to be accurate (subject to change without prior notice); however, use of such information shall be entirely at the user's own risk.

Immunity: EN 61000-6-2 Emissions: EN 61000-6-4